

Memory Link Server (Extend Mode - Binary)

Connect external device.

HMI Setting:

Parameters	Recommend	Option	Notes
PLC type	Memory Link Server (Extend Mode - Binary)		
Com port	RS232		
Baud rate	9600	1200~115200	
Parity bit	None	Even, Odd, None	
Data Bits	8	8	
Stop Bits	1	1	
HMI Station No.	0		
PLC Station No.	0		

Online Simulator	YES	Extend address mode	NO
Broadcast command	NO		


Device address:

Bit/Word	Device Type	Format	Range	Memo
B	LW_bit	dddd(dd)	dddd:0~8191 (dd): 0~15	Mapping to LS bit address
W	LW	dddd	dddd:0~8191	Mapping to LS

Wiring diagram:


RS-232:

MT8000 RS232
9P D-SUB

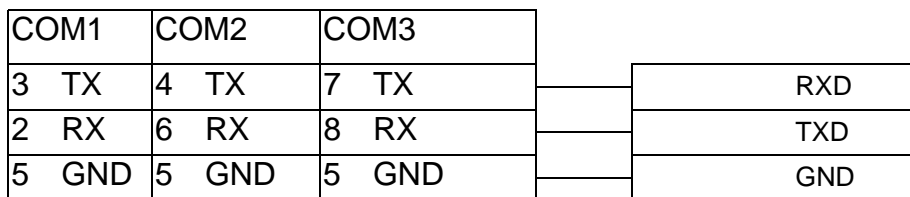

RS-485:

MT8000 PLC[485]
9P D-SUB

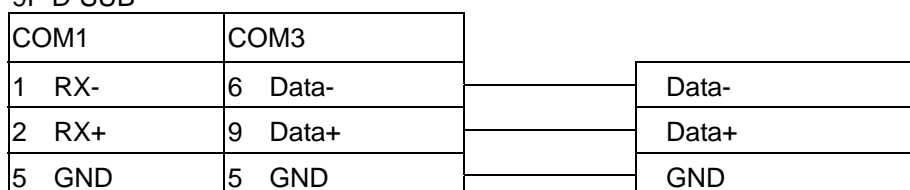

Memory Link Command:

Read command

Read LS 10, 1word

Device send: 1B 52 00 0A 00 01 78

HMI response: 1B 41 00 00 03 5F

Device send

0x1B	0x52	0x00 0x0A	0x00 0x01	0x78
ESC	R	Address(2 bytes)	Number of data(2 bytes)	Sum check code

ESC R Read command

The sum check is the lower one byte of the sum of all data.

$$1B + 52 + 00 + 0A + 00 + 01 = 78$$

HMI response

0x1B	0x41	0x00 0x00	0x03	0x5F
ESC	A	Data 1(2 bytes)	ETX	Sum check code

$$1B + 41 + 00 + 00 + 03 = 5F$$

Write command

Write LS 10, 1word

Device send: 1B 57 00 0A 00 01 01 00 7E

HMI response: 06

Device send

0x1B	0x57	0x00 0x0A	0x00 0x01	0x7E
ESC	W	Address(2 bytes)	Number of data(2 bytes)	Sum check code

ESC W Write command

The sum check is the lower one byte of the sum of all data.

$$1B + 57 + 00 + 0A + 00 + 01 = 7E$$

HMI response

0x06
ACK

ACK write success.