



# User's Manual of AI/AQ Extension Module

v2.0 Copyright © 2005 Xiamen Haiwell Technology Co., Ltd

## 1. Product Model List

Type with ethernet	24VDC power supply	Type with ethernet	220VAC power supply	Type	24VDC power supply	Type	220VAC power supply	Dimension
				S04AI	1.8 VA	S04AI2	2.2VA	70×95×82mm
				S04AO	3.6 VA	S04AO2	4VA	
				S04XA	2.4 VA	S04XA2	3VA	
				H04RC	1.5 VA	H04RC2	2VA	
				H04TC	1.5 VA	H04TC2	2VA	93×95×82mm
				H08TC	1.8 VA	H08TC2	2.2VA	
S08AI-e	2.7 VA	S08AI2-e	3.1VA	S08AI	2.1 VA	S08AI2	2.5VA	
S08AO-e	7.1 VA	S08AO2-e	7.6 VA	S08AO	6.5 VA	S08AO2	7 VA	
S08XA-e	5.1 VA	S08XA2-e	5 VA	S08XA	4.5 VA	S08XA2	5 VA	
H08RC-e	2.4 VA	H08RC2-e	2.3 VA	H08RC	1.8 VA	H08RC2	2.3 VA	



## 2. Indicator Description

- ① POW: power indicator green, constant light - Power normal; Not light - Power error.
- ② LINK: many state indicator, three colors (Red, Yellow, Green), as follows:

Consult manage	Module bus state	LINK the state of the indicator
Normal	Module no communication	Not light
	MPU identification the module but have not communication	Green constant light
	Serial or parallel communicating	Green flicker: indicator light 30ms not light 30ms
parallel power supply not enough, must connect to external power supply	Without serial or parallel communicate	Yellow flicker: indicator light 0.5s not light 0.5s
	With serial or parallel communicate	Yellow dark and shake alternately: indicator not light 0.5s shark 0.5s
Upgrade the fireware fail, reupgrade the fireware of the module	Without serial or parallel communicate	Red flicker: indicator light 0.5s not light 0.5s
	With serial or parallel communicate	Red dark and shake alternately: indicator not dark 0.5s shark 0.5s
Maintain	Without serial or parallel communicate	Red constant light
	With serial or parallel communicate	Red shark quickly: indicator light 30ms not light 30ms

## 3. Power Supply Specification

Item	DC Power Supply	AC Power Supply
Power Supply Voltage	DC24V -15%~+20%	100~240VAC
Power Supply Frequency	—	50~60Hz
Instantaneous Surge	MAX 20A 1.5ms @24VDC	20A 1.5ms MAX @220VAC
Power Loss Time	10ms or less	20ms or less @220VAC
Fuse	0.3A, 250VAC	2A, 250VAC
24V Output Voltage (for output and extension)	None	24V, -15%~+15%, 300mA MAX
Insulation Type	No Electrical isolation	Transformer isolation or optoelectronic isolation, 1500VAC/1 minute
Power Protection	DC input power polarity reverse, over voltage	DC24V output over current

## 4. Environmental specifications for Product

Item	Environment Specification
Temperature/Humidity	Operating temperature: 0~+55℃ Storage temperature: -25~+70℃ Humidity: 5~95%RH, No condensation
Vibration Resistance	10~57 HZ, amplitude=0.075mm, 57HZ~150HZ acceleration=1G, 10 times each for X-axis, Y-axis and Z-axis
Impact Resistance	15G, duration=11ms, 6 times each for X-axis, Y-axis and Z-axis
Interference Immunity	DC EFT: ±2500V Surge: ±1000V
Over Voltage Resistance	1500VAC/1min between AC terminal and PE terminal, 500VAC/1min between DC terminal and PE terminal
Insulation Impedance	≧ 5MΩ between AC terminal and all input/output points to PE terminal @500VDC
Operating environment	Avoid dust, moisture, corrosion, electric shock and external shocks

## 5. Analog Input (AI) Specification


Item	Voltage input				Current input	RTD input	Thermocouple Input
Input range	-10V~+10V	0V~+10V	0V~+5V	1V~+5V	0~20mA 4~20mA	Pt100, Pt1000 Cu50, Cu100	S, K, T, E, J, B, N, R, Wre3/25, Wre5/26, [0,20]mV, [0,50]mV, [0,100]mV
Resolution	5mV	2.5mV	1.25mV	1.25mV	5uA	0.1℃	0.1℃
Input impedance	6MΩ				250Ω	6MΩ	6MΩ
Maximum input range	±13V				±30mA		±5V
Input indication	LED light means normal, dark means break OFF						
Response time	5ms/4 Channel				560ms/4 Channel, 880ms/8 Channel		
Digital input range	12 bits, Code range: 0~32000 (H series module 16 bits A/D convert)				16 bits, Code range: 0~32000		
Precision	0.2% F.S				0.1% F.S		
Power supply	MPU use internal power supply, extend module use external power supply 24VDC ±10% 5VA						
Isolation mode	Opto-electric isolation, Non-isolation between Channel, between analog and digital is opto-electric isolation						
Power consumption	24VDC ±20%, 100mA (maximum)				24VDC ±20%, 50mA (maximum)		

## 6. Analog Output (AQ) Specification


Item	Voltage output				Current output	
Output range	-10V~+10V	0V~+10V	0V~+5V	1V~+5V	0~20mA	4~20mA
Resolution	5mV	2.5mV	1.25mV	1.25mV	5uA	5uA
Output load impedance	1KΩ@10V				≥500Ω@10V	
Output indication	LED light means normal					

Drive capability	10mA
Response time	3ms
Digital output range	12 bits, Code range: 0~32000 (H series module 16 bits D/A convert)
Precision	0.2% F.S
Power supply	MPU use internal power supply, extend module use external power supply 24VDC ±10% 5VA
Isolation mode	Opto-electric isolation, Non-isolation between Channel, between analog and digital is opto-electric isolation
Power consumption	24VDC ±20%, 100mA (maximum)


## 7. Analog Input (AI) Wiring

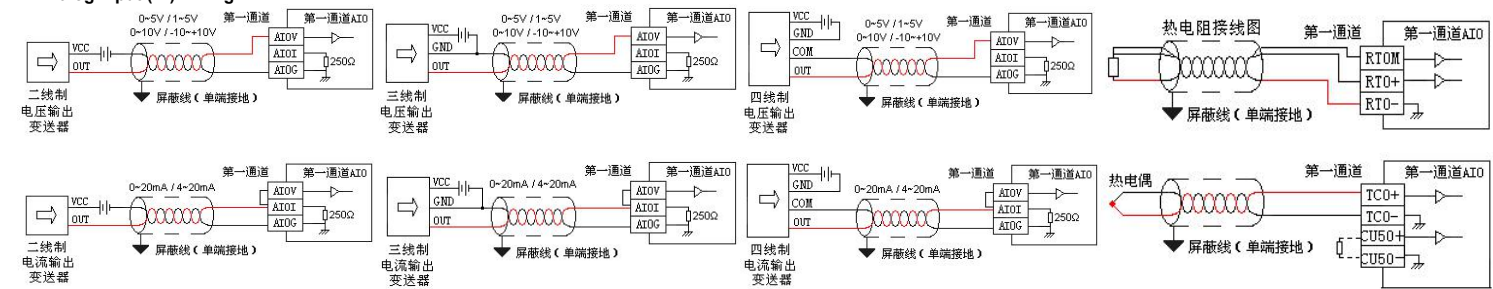

## 8. Analog Output (AO) Wiring

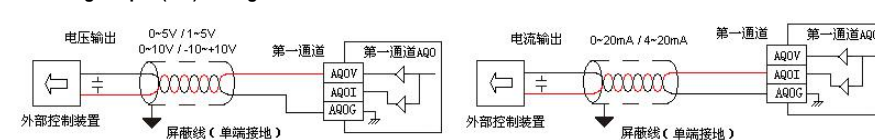

## 9. MPU Terminal Wiring Diagram

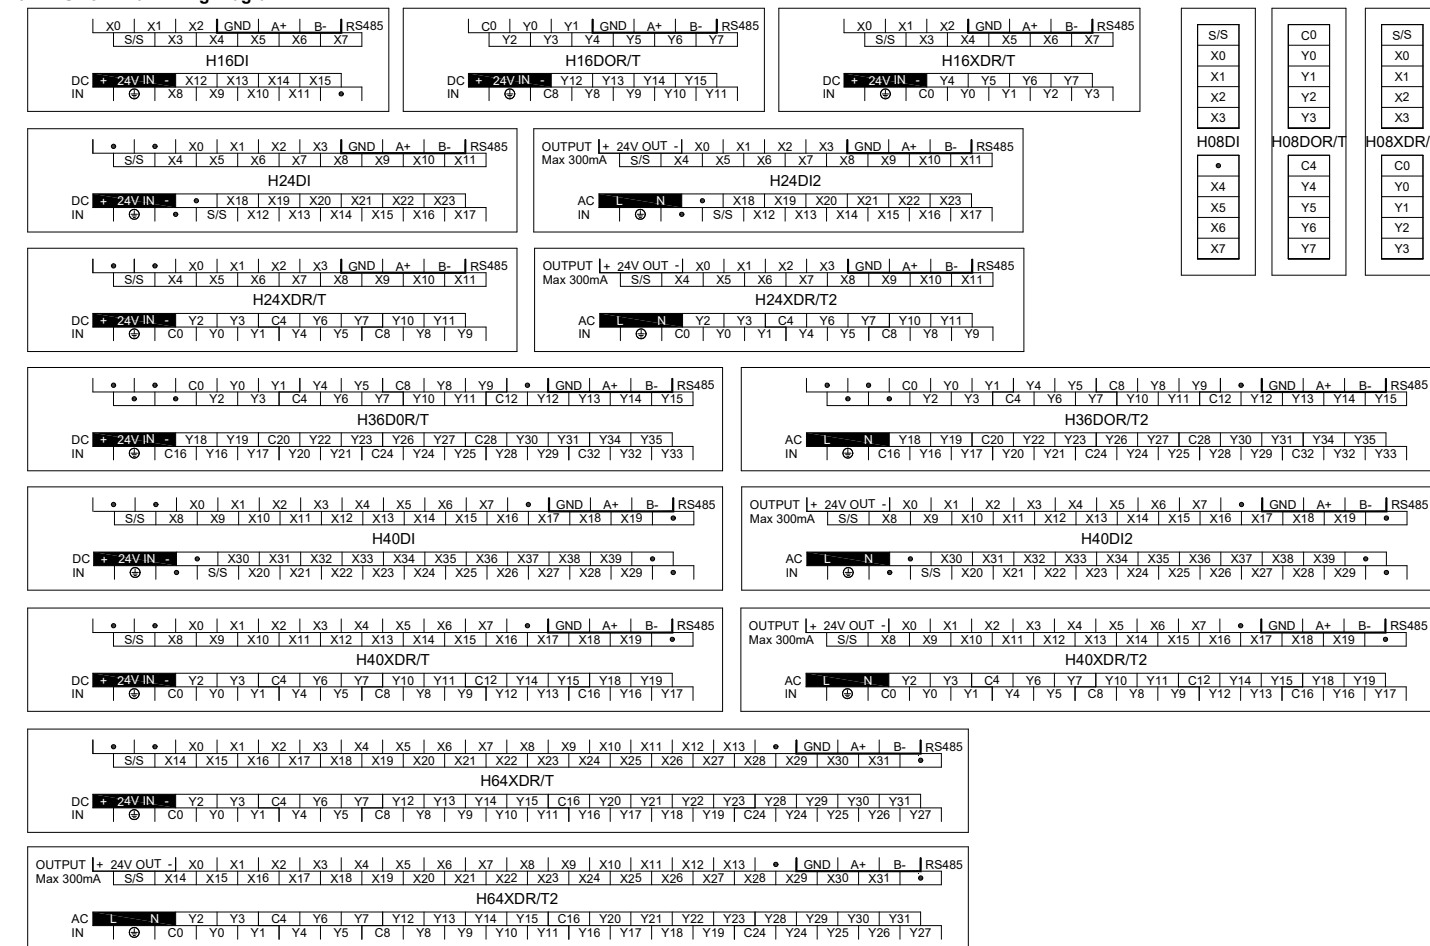


## 10. Mounting and installation

The PLC should be secured to an enclosed cabinet while mounting. For heat dissipation, make sure to provide a minimum clearance of 50mm between the unit and all sides of the cabinet. (See the figure.)

**Rail Mounting:** Use standard 35 mm rail.

**Screw Mounting:** Each MPU or extension module has two positioning screw holes, the diameter of the hole is 4.5mm. Please refer to the dimension figure for the location of the positioning holes and their spacing. To avoid over temperature and for a better heat dissipation, do not mount PLC to a position near to the bottom/top of the cabinet. Do not mount PLC in vertical direction.

**Extension Module Wiring:** Connections between extension modules and connections between module and MPU are achieved through bus-A extension cable will be configured to every extension module, for the connection between two different modules. Connection methods: turn the right side of extended interface (the last MPU or extension module) over, plug the extension cable in the extended interface, then press down the cover of the extended interface to reset the interface, the extended interface at the right side of the module will be reserved for extension of the next module. Connect all extension modules in turn in the same way.



## 11. Address Setting

Modules with ethernet port, default IP address 192.168.0.111. Hardware DIP switch address range 1-15, default address 1. If you need to set bigger range of address, you can set it in the "remote module-tool-menu" of the PLC software after online, and then download the program to the plc, software address range 16-254 (hardware address is prior to software address).

Thanks for choosing Haiwell PLC, if you have any questions about our products or services, please let us know!

Haiwell website: <http://www.haiwell.com> <http://www.haiwell.cn>